

LEGEND

- ALLOWABLE DRIVEWAY ACCESS
- SEWER MAIN & MANHOLE
- WATER MAIN, FIRE HYDRANT & SLUICE VALVE
- STORMWATER DRAINAGE LINE
- SUBSOIL DRAIN & CLEANOUT POINT
- EXISTING SEWER MAIN & MANHOLE
- EXISTING SEWER RISING MAIN
- EXISTING WATER MAIN
- EXISTING STORMWATER
- BUILDING SETBACK, REFER NOTE 3
- EXISTING UNDERGROUND OPTICAL FIBRE
- STREET TREES

BUILDING ENVELOPES

- IN ORDER OF PRECEDENCE, BUILDING ENVELOPE SETBACKS ARE TO COMPLY WITH THE DESIGN CODE SHOWN ON THIS PLAN THEN THE REQUIREMENTS OF THE QUEENSLAND DEVELOPMENT CODE (QDC). THESE SETBACKS MAY VARY TO ACCOMMODATE THE ZONE OF INFLUENCE OF UNDERGROUND SERVICES AS STATED IN COUNCIL'S POLICY ON BUILDING OVER ADJACENT SEWERS. REFER TO QDC MP 1.2 FOR PROPOSED BUILDING SETBACKS NOT SPECIFIED ON THIS PLAN.
- THE OUTERMOST PROJECTION (OP) IS A DISTANCE MEASURED FROM THE EDGE OF THE FASCIA BOARD TO THE PROPERTY BOUNDARY.
- THE WALL SETBACK DISTANCE IS A DISTANCE MEASURED FROM THE FACE OF THE WALL TO THE PROPERTY BOUNDARY. NOTE: EAVE OVER HANG MAY PROJECT UP TO 600mm.

DRIVEWAY ACCESS ENVELOPES


- FOR DRIVEWAY ACCESS ENVELOPES ALLOW 0.5m MINIMUM CLEARANCE TO ALL COUNCIL INFRASTRUCTURE, EXCEPT STORMWATER PITS WHICH REQUIRE 0.6m MINIMUM CLEARANCE, AND SEWERAGE HOUSE CONNECTIONS WHICH REQUIRE 1.2m CLEARANCE. ALL DRIVEWAYS REQUIRE A PERMIT FROM COUNCIL.

DESIGN CODE - ALL ALLOTMENTS

TYPE	HOUSE, FRONT LOADED
LOT ACCESS	FRONT
LOT DEPTH (MIN)	25m (20m WHERE 15m WIDTH PROPOSED)
LOT WIDTH (MIN)	10.0m
SITE COVERAGE	MAY EXCEED 50% IN RESPONSE TO CODE REQUIREMENTS, BUT NO MORE THAN 60% SITE COVERAGE.
SETBACK FRONT GROUND (MIN) AND UPPER (MIN)	4.5m
SETBACK FRONT GARAGE	6m AND 1.5m BEHIND FRONT OF DWELLING
SETBACK CLASS 1A / PRINCIPAL SIDE GROUND (MIN)	QDC
SETBACK CLASS 1A / PRINCIPAL SIDE UPPER (MIN)	QDC
SETBACK SECONDARY ROAD FRONTAGE (MIN)	3m
SETBACK CLASS 1A / PRINCIPAL REAR (MIN)	1.5m (SEWER LINES AND MANHOLES MAY ENFORCE GREATER SETBACKS)
CLASS 10A / OUTBUILDING (SHED) WIDTH (MAX)	LESSER OF 50% OF REAR BOUNDARY OR 9m**
CLASS 10A / OUTBUILDING (SHED) DEPTH (MAX)	9m**
CLASS 10A / OUTBUILDING (SHED) REAR SETBACK	0-1.0m**
CLASS 10A / OUTBUILDING (SHED) SIDE SETBACK	ZERO IF LOT 12.5m WIDE. AS PER PRINCIPAL SETBACK IF LOT >12.5m WIDE**
FLOOR HEIGHT CLASS 1A / PRINCIPAL (MIN)	400mm
MAXIMUM STOREYS	AS PER THE APPLICABLE SCHEME
PRIVATE OPEN SPACE (MIN) (MAY BE COVERED)	4mx4m
PARKING (MIN)	TWO (2), ONE OF WHICH MUST BE COVERED

*NOTE: CLEARANCES TO SEWER LINES AND MANHOLES ARE REQUIRED IN ACCORDANCE WITH COUNCIL POLICY.
**NOTE: SETBACKS APPLY TO CLASS 10A / OUTBUILDING (SHED) STRUCTURE WITH MAXIMUM HEIGHT OF 3.5m. WHERE THE STRUCTURE EXCEEDS THIS HEIGHT (OR OTHER MAXIMUM DIMENSIONS), SETBACKS ARE TO DEFAULT TO THE QDC.

LIGHT POLES & TELSTRA PITS HAVE NOT BEEN SHOWN

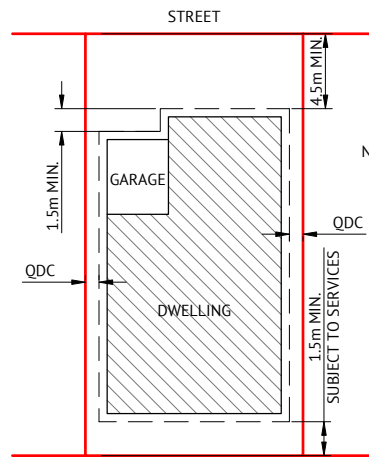


TYPICAL SETBACK REQUIREMENTS

NOTES

- 60% MAXIMUM SITE COVERAGE.
- FOR FRONT SETBACK TO GARAGE, MEASURE FROM THE FRONT BOUNDARY TO THE GARAGE OPENING (WALL).
- ALL OTHER SETBACKS ARE MEASURED FROM THE BOUNDARY TO THE OUTERMOST PROJECTIONS.

HOUSE CONNECTION DETAIL

NOTE: MINIMUM 1.0m CLEARANCE FROM END OF SEWER HOUSE CONNECTION TO THE NEAREST POINT OF THE STRUCTURE FOUNDATION OR 2.0m CLEARANCE FROM CONNECTION AT MAIN/CENTRE OF MANHOLE.

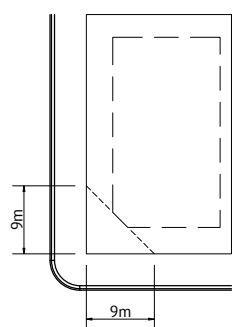

STANDARD CORNER BUILDING SETBACK

SCALE 1:500

ISSUED FOR CONSTRUCTION

DATE	REV	DESCRIPTION	REVISIONS
18/12/2025	E	BUILDING SETBACKS AMENDED	KK AP
05/12/2025	D	BUILDING SETBACKS AMENDED	KK AP
13/11/2024	C	STREET TREES ADDED	JJ AP
29/04/2025	B	BUILDING ENVELOPE DETAILS ADDED	JJ AP
23/07/2024	A	ISSUED FOR CONSTRUCTION	JJ AP
31/05/2024	1	PRELIMINARY - NOT FOR CONSTRUCTION	JJ PP



TOWNSVILLE OFFICE
84 DENHAM STREET
PO BOX 1110
TOWNSVILLE, QLD 4810
PH: (07) 4772 0666
WEB: www.premise.com.au

DESIGNED JJONES
CHECKED ZSTROGUSZ
PROJECT MANAGER ZSTROGUSZ
ENGINEERING CERTIFICATION
A.PEASE RPEQ 22556

SCALE
0 10 20 30m
SCALE 1:500 (A1)
ORIGINAL SHEET SIZE A1

CLIENT

PROJECT
LOCATION
SHEET TITLE

ELEMENTS RASMUSSEN PTY LIMITED

RIVERSTONE - PRECINCT 1 - STAGE 2
SOUTH BECK DRIVE, RASMUSSEN
BUILDING ENVELOPE & DRIVEWAY ACCESS PLAN

JOB CODE

P000870

SHEET NUMBER
C022

REV
E